



.....	1
.....	1
.....	2
.....	6
.....	7
.....	7
.....	7
.....	8

1

1 AC220V $\pm 10\%$

2 10KVA

3 0-50A

4 AC0-250V

5 0-50A

6 1%

7 1%

2

1 AC0-220V


2 10KVA

3 0-50A

4 AC0-100kV

5 0-100mA

6 AC0-100V

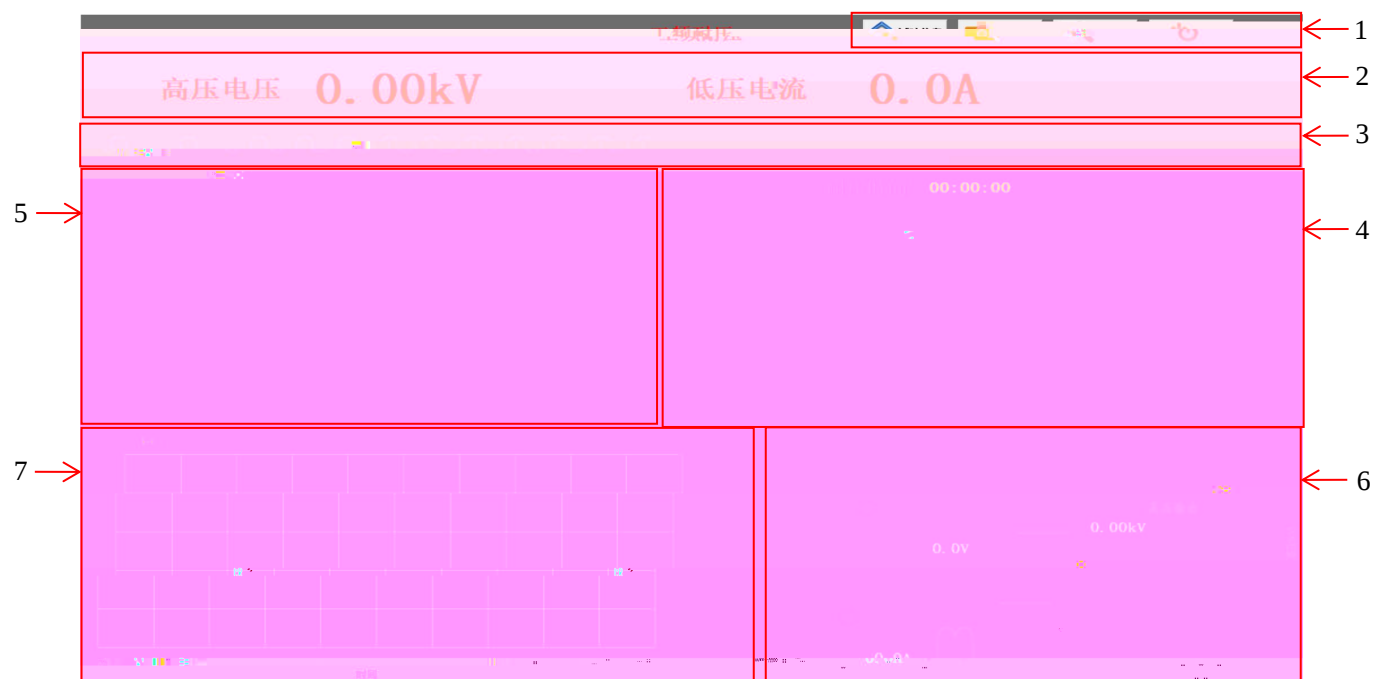

1

2

3

4

/

5

6

7

1.



1



2.



3.



3

1

4.

1 3

IJ

I


①

1.

4



5

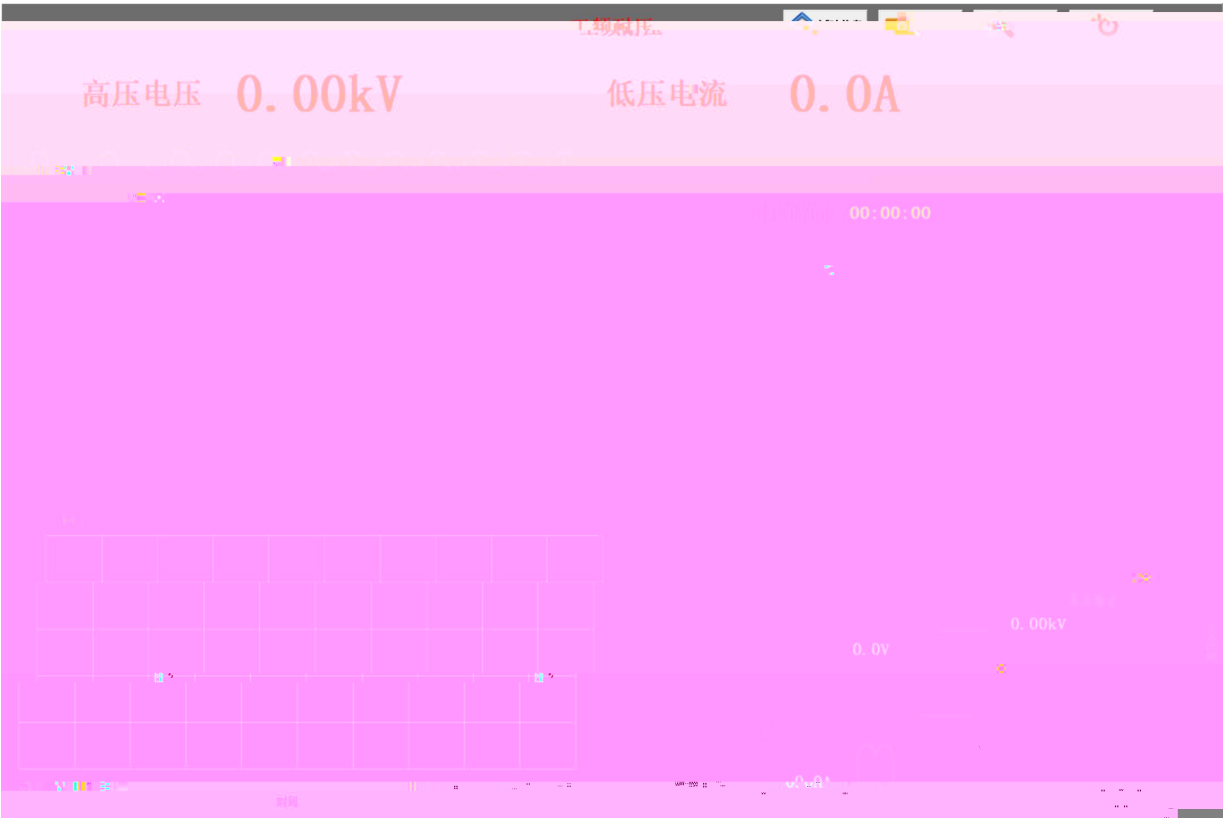

4

请设置耐压阶段

添加调压阶段：

阶段	电压目标值 (kV)	工作时间 (秒)
(1)	10.0	60

添加

确定 取消

2.  5
1



3. 
 /

②

1. 7



2. 


 80%


③

1.


9

10



9

2.

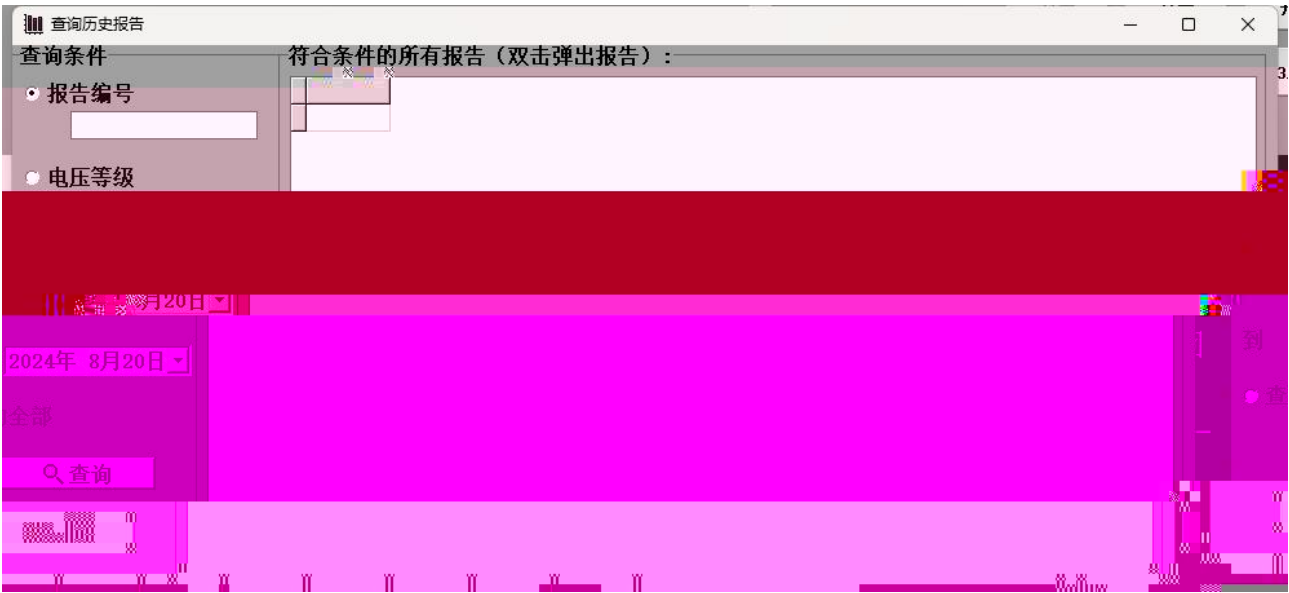

10

- 1

-25--+45
- 2

<100M
- 3

<90%
- 4

:

1

2

3 : 220V ± 10% 50Hz

4

5

6

7

1

2

1

2

1		1
2		1
3		1
4		1
5		1
6		1
7		1