



—

---

---

---

---

|       |   |
|-------|---|
| ..... | 5 |
| ..... | 5 |
| ..... | 5 |
| ..... | 5 |
| ..... | 6 |
| ..... | 7 |
| ..... | 7 |
| ..... | 8 |
| ..... | 8 |

UHV-409

UHV-409

GKC-1

1

2

(            )

3

1-999

4


10-2000

5

6

7

|   |             |          |     |
|---|-------------|----------|-----|
| 1 | AC220V ± 15 | 50Hz     | 15A |
| 2 |             | 15A      |     |
| 3 | AC/DC10     | 250V/10A |     |
| 4 | AC/DC10     | 250V/10A |     |
| 5 | AC/DC10     | 250V/10A |     |
| 6 | 1           |          |     |
| 7 | 0           | 60000    |     |

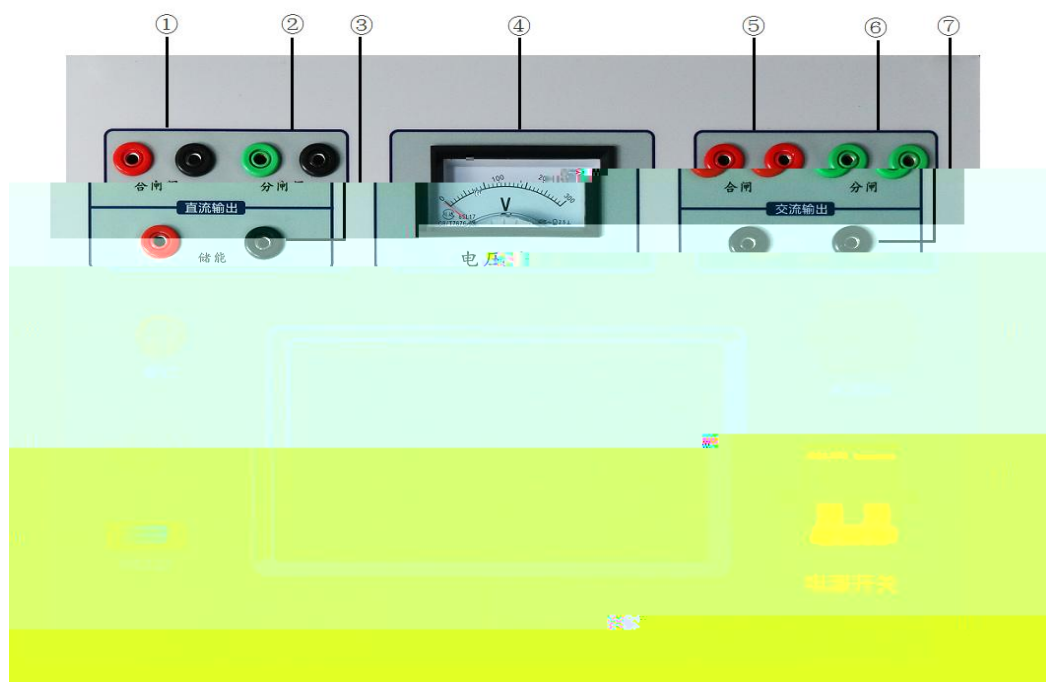

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_



1

2 AC220V/15A

3

4

1

2  $\leq 2000\text{m}$

3 -5 40

4  $\leq 90\%$

5 AC220V  $\pm 10\%$

6 50Hz  $\pm 2\text{Hz}$

7

8

|   |   |   |   |   |   |
|---|---|---|---|---|---|
| 1 |   | 2 |   |   |   |
| 2 |   | 2 |   |   |   |
| 3 |   | 2 |   |   |   |
| 4 |   |   | 1 |   |   |
| 5 |   | 1 |   |   |   |
| 6 |   |   | 3 | 2 | 1 |
| 7 | 1 |   |   |   |   |